




User Guide

Document Revision - VO 76 E

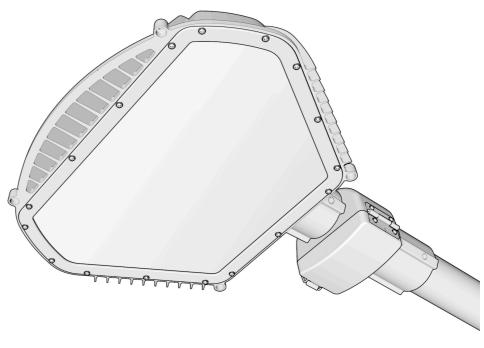

▲ ET (Junction Box Type)


Safety precautions


- 1. Electrical work must be performed by a qualified licensed electrician.
- 2. Disconnect or turn off power before installation or servicing.
- 3. Do not take apart or modify the product.
- 4. Do not drop the product or apply a strong impact to it.
- 5. The manufacturer or the seller do not bear liability for damage caused by inappropriate use or application.
- 6. Contact the manufacturer or the seller for inquiry when there is a problem with the product.

For luminaires with type Y attachments, the mounting instructions shall contain the substance of the following information for type Y attachments.

If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.

LED Roadway Lighting

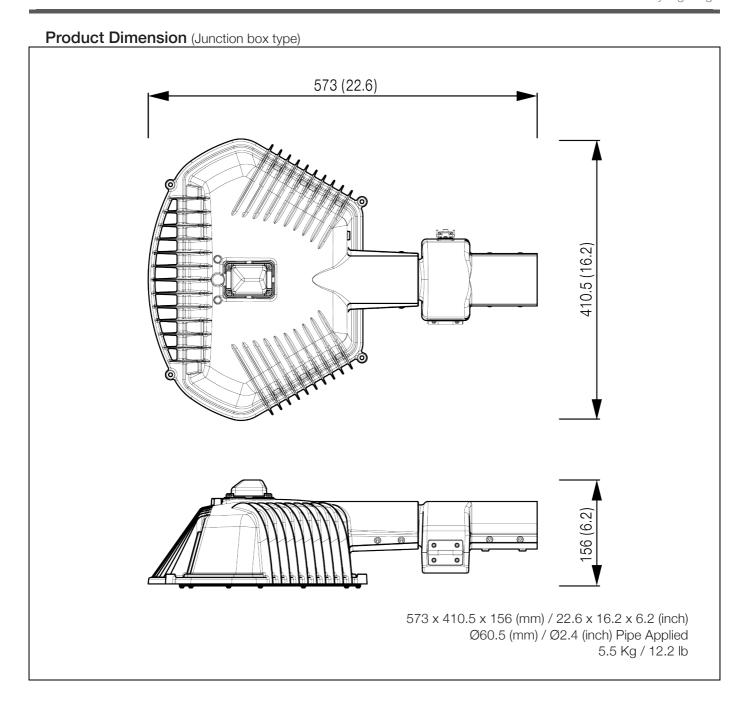


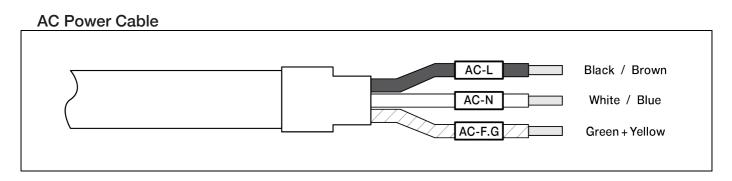

LED Roadway Lighting

Installation Instruction Connect the AC Cable to the main power supply by using a connector. (Refer to "AC Power Cable")

LED Roadway Lighting

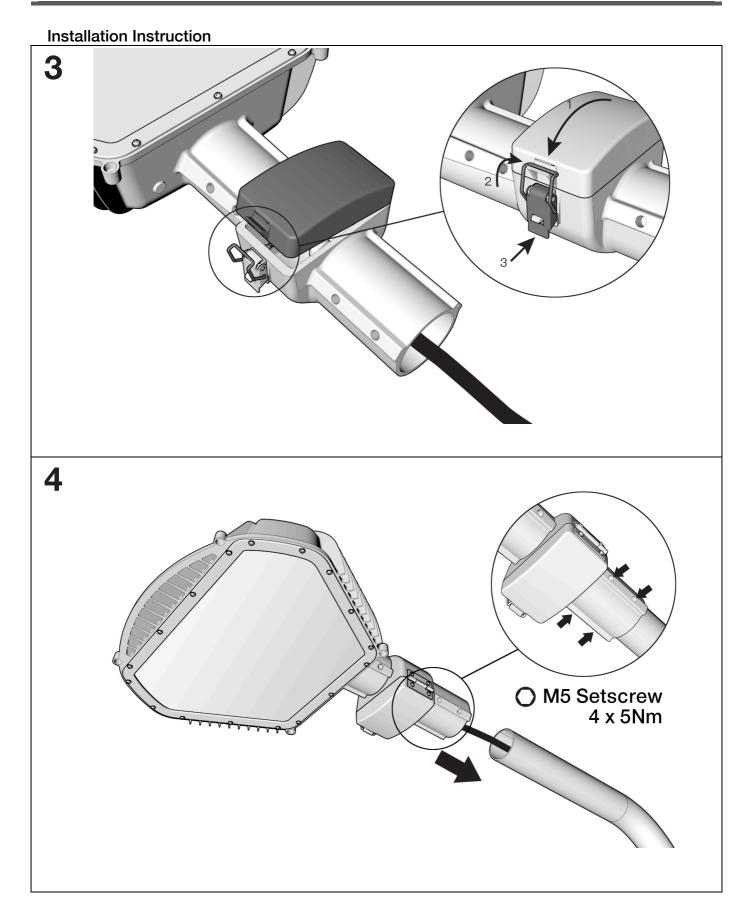

LED Roadway Lighting

